


广州智光自动化有限公司

地址：广州市黄埔区云埔工业区埔南路51号



电话：(020)32113398

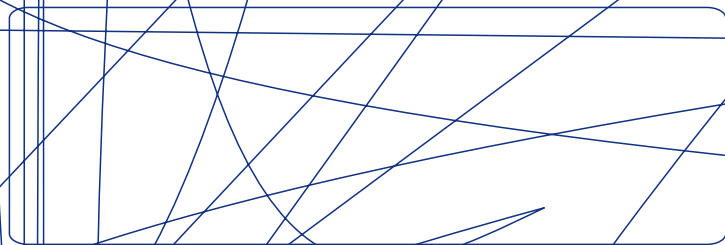

02 公司简介



资质荣誉

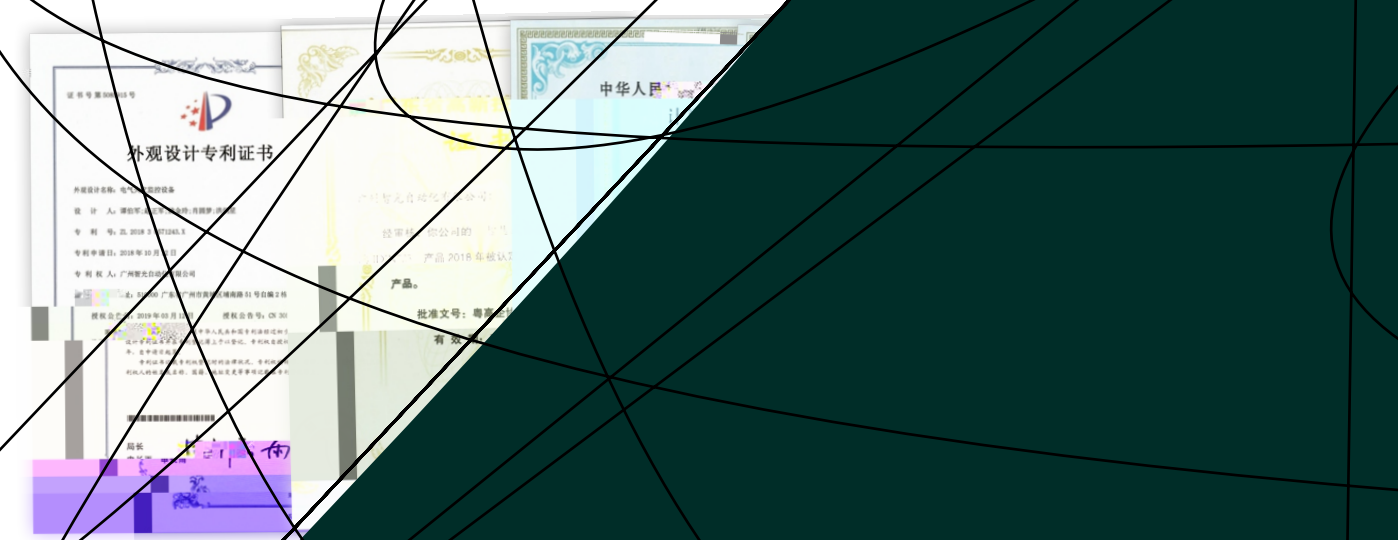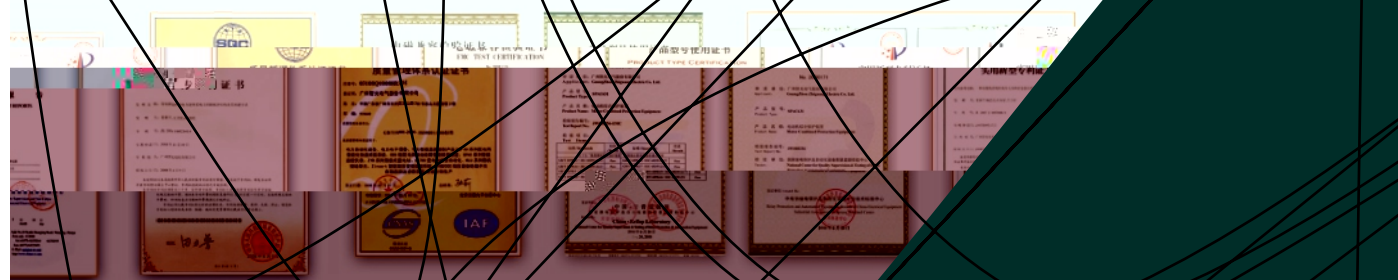



说明

IDIN719S适用于TN-C-S系统、TN-S系统及局部TT系统。

| DIN719S | |
|------------------|----------------|
| GB14287.2-2014 | GB14287.3-2014 |
| 8 | |
| 1 | |
| 0.5 | 2C |
| 85-265Vac | |
| <4VA | |
| <0.2% | |
| AC 2kV/min-1mA | |
| >100M | |
| 2 | |
| 220Vac/5A, 30Vdc | |
| -10C - 55C | |
| -25C - 55C | |
| -40C - 70C | |
| 5% - 95% | |
| 90mm×90mm | |





过流

≤ 2000A

过压

<600VAC

1000mA

0.5mA

完全满足国标GB28184-2011《消防设备电源监控系统》的要求；

与站

电压信号传感器



产品特点

- GB28184-2011
-
-
- DC24V
-
-

设计选型表

| 1 | 电压信号传感器 | ZGU-K1 | |
|---|---------|--------|--|
| 2 | | ZGU-P1 | |
| 3 | | ZGU-P2 | |
| 4 | | ZGU-N1 | |
| 5 | | ZGU-N2 | |
| 6 | | ZGU-Z1 | |

技术参数

| | |
|---------|------------------------------------|
| | DC10V-DC42V |
| | 0.3W |
| + | ZR- RVSP - 2x 2.5mm ² + |
| | |
| | 0- 60s |
| | 110%, 85% |
| | LED |
| | AC0-500V |
| | -20 ~+70 |
| | 95% |
| | 4500m |
| | IP42 |
| (× ×) | 109mm×87mm×47mm |
| | 35mm |



电压/电流信号传感器



产品特点

- GB28184-2011
-
-
-
- DC24V
-
-

设计选型表

| | 电压/电流信号传感器 | | | |
|---|------------|---------|--------|--------|
| 1 | | ZGI-K | 100: 5 | 1 ZT-T |
| 2 | | ZGI-K2A | 100: 5 | 1 ZT-T |
| 3 | | ZGI-P | 100: 5 | 3 ZT-T |
| 4 | | ZGI-P2A | 100: 5 | 3 ZT-T |

技术参数

| | |
|---------|-----------------------------------|
| | DC10V-DC42V |
| | 0.3W |
| + | ZR- RVSP- 2x 2.5mm ² + |
| | |
| | 0- 60s |
| | 110%, 85% |
| | LED |
| | AC0-500V 0-1000A |
| | -20 ~ + 70 |
| | 95% |
| | 4500m |
| | IP42 |
| (× ×) | 109mm× 87mm× 47mm |
| | 35mm |



| | |
|---|------------|
| | 118x26x118 |
| | 142x142x26 |
| / | 223x115x50 |
| / | 245x192x57 |



